

Engineering Service Specifications

Commercial Single-Phase Metering Schemes (*Self-contained meter base no CTs required*)

SLEMCO

Specifications for Commercial Underground Secondary Requirements

Applicable to commercial services receiving single-phase power at 120/240 volts through a 200 Amp meter base attached to building requiring service. The meter base service conductors enter through an underground conduit from either an underground or overhead source.

The *Point of Connection* is the point of demarcation between SLEMCO and the customer. It will be the customer's responsibility for compliance with the National Electrical Code (NEC) and any governing authority for all equipment beyond the *Point of Connection*. The customer is advised to use the services of a qualified electrician to assure compliance with all codes and regulations.

It should be noted that electrical pipe is the gray pipe and white water pipe is not acceptable. Therefore, schedule 40 or 80 electrical pipe discussed in this section is approved electrical conduit.

Items marked with ②③④ are indicated on the following drawings:

② Drawing No.2 – Single-Phase Underground Service Requirements from an Existing Padmount Transformer

③ Drawing No.3 – Single-Phase Underground Service Requirements from a new Padmount Transformer

④ Drawing No.4 – Single-Phase Underground Service Requirements from an Overhead Source

- A. Secondary conductors from transformer to meter base are furnished and installed by SLEMCO. ②③④ Secondary conductors will be terminated by SLEMCO to source side of the meter base (*Point of Connection*).
- B. Secondary conduit furnished and installed by customer. After trenching, the trench may be backfilled and covered. Conduit must be 2" electrical conduit. Electrical schedule 40 pipe is acceptable for below ground use. ②③④
- C. Above ground riser conduit must be 2" electrical schedule 80 pipe. If elbows are required, then PVC elbows shall be used. LB elbows and flex conduit cannot be used. ②③④
- D. Any underground service that requires three 90° (*degree*) turns or is further than 150', the customer must use standard steel 90° elbows with an 18" turn. A maximum of three 90° turns are allowed. Any underground service which is less than 150' with two or less 90° turns, the customer is allowed to use PVC long radius 90° elbows with a 36" turn. ②③④
- E. Customer must maintain a depth of 36" when installing electrical conduit for secondary conductors. ②③④
- F. **F1** If the customer is getting power from an overhead source, then the customer will stub up at the SLEMCO pole 36" above finished grade with 2" electrical schedule 80 pipe. ④ The customer will also be required to leave three (3) joints of 2" electrical schedule 40 pipe near the pole to be used by SLEMCO to install the riser up the pole even with neutral or bottom of transformer. The customer will also provide a 2" weather head along with the electrical schedule 40 pipe. According to National Electric Safety Code (NESC) Table 232-1, Item 5., Note 8(d), the lowest point of the service conductor (*drip loop*) must be at least 10' above final grade.

SLEMCO

Specifications for Commercial Underground Secondary Requirements

Items marked with ②③④ are indicated on the following drawings:

- ② Drawing No.2 – *Single-Phase Underground Service Requirements from an Existing Padmount Transformer*
- ③ Drawing No.3 – *Single-Phase Underground Service Requirements from a new Padmount Transformer*
- ④ Drawing No.4 – *Single-Phase Underground Service Requirements from an Overhead Source*

F2 If the customer is getting power from an existing padmount transformer, then the customer must stop the electrical conduit 1' short of the transformer pad. The customer conduit must be installed perpendicular (*in direction of arrows*) to the area (*shown in gray*) marked as 1' from edge of transformer pad surrounding the bushing enclosure of the padmount transformer. ② Unacceptable installations include installing conduit from the rear of the transformer or installing conduit that is not perpendicular to the bushing enclosure of the padmount transformer. SLEMCO will install and provide the PVC long radius 90° elbow and electrical conduit into the transformer.

F3 If the customer is getting power from an existing pedestal, then the customer must stop the electrical conduit 1' short of the pedestal's edge.

F4 If the customer is getting power from a new padmount transformer, then the customer must stub up the secondary and primary electrical conduit next to each other at the location of new padmount transformer. ③ See the next section entitled, *Specifications for Residential Underground Primary Requirements*, for details on primary installation.

G. Standoff brackets furnished and installed by SLEMCO. ④

H. Customer will complete installation of electrical conduit into bottom left side of meter base using 2" electrical schedule 80 pipe for section above finished grade into meter base. If elbows are required, then PVC elbows shall be used. LB elbows and flex conduit cannot be used. ②③④

I. Customer will install a polypropylene pull string (*minimum strength of 210 lbs.*) in all electrical conduit that will require SLEMCO to install secondary conductors.

J. Meter base furnished and installed by customer. When purchasing a meter base for underground service please specify hubless or underground meter base. The meter base shall be mounted on the outside of the building such that the center of the meter socket window is between 5' and 6' above finished grade. ②③④ The meter base shall conform to SLEMCO's standards and shall be compatible with SLEMCO metering. The meter base shall be rated for 200 Amps.

K. The main disconnect (*service panel*) and customer conductors (*from load side of the meter base to the main disconnect*) are furnished and installed by customer. The main disconnect shall be sized for 200 amps and located within 3' of the meter base. The customer conductors shall be sized for 200 Amps of load, as required by the NEC or Governing Authority. The main disconnect and or other electrical equipment may be mounted on the outside of the building. However, it must be of weather proof and watertight design to be mounted on the outside. ②③④

SLEMCO


Specifications for Commercial Underground Secondary Requirements

Items marked with ②③④ are indicated on the following drawings:

- ② Drawing No.2 – *Single-Phase Underground Service Requirements from an Existing Padmount Transformer*
- ③ Drawing No.3 – *Single-Phase Underground Service Requirements from a new Padmount Transformer*
- ④ Drawing No.4 – *Single-Phase Underground Service Requirements from an Overhead Source*

- L. The customer will be responsible to furnish the meter base ground wire (*minimum #6 soft drawn copper*) and install this wire in electrical conduit from the meter base to the ground rod. The meter base ground wire shall be connected in the ground wire lug, where provided, and not in the service neutral lug. ②③④
- M. Ground rod, minimum 5/8" x 8' copperweld or 1/2" x 8' copper, furnished and installed by customer. Ground rod is to be set 1" below finished grade. ②③④ This is the minimum required by SLEMCO. Additional grounding may be required by the NEC or Governing Authority.
- N. Variations of this design may be considered equal as long as NEC requirements are met. To assure acceptability where variations arise, contact SLEMCO prior to installation.
- O. If a Governing Authority requires inspection, inspection tag must be in place and marked approved before SLEMCO will connect service. ②③④

TOP VIEW


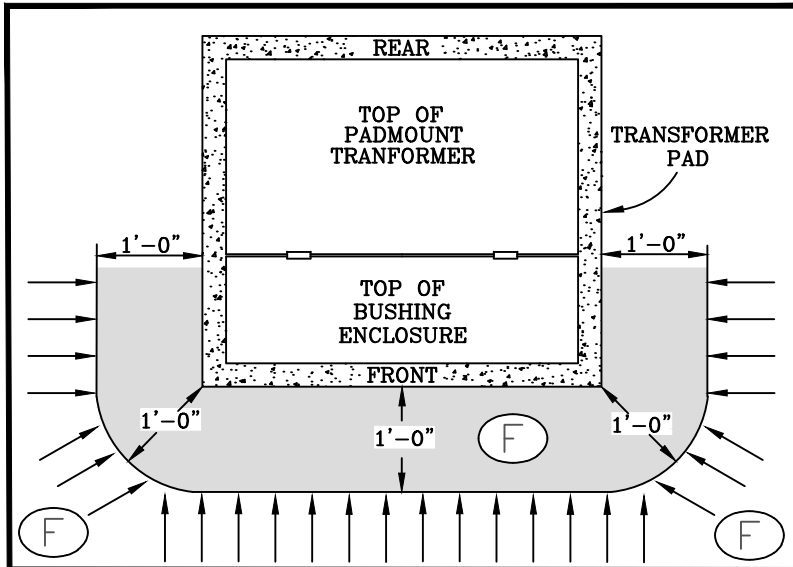


CUSTOMER CONDUIT MUST BE INSTALLED PERPENDICULAR (IN DIRECTION OF ARROWS) TO THE AREA (SHOWN IN GRAY) MARKED AS ONE FOOT FROM EDGE OF PAD SURROUNDING THE BUSHING ENCLOSURE OF THE PADMOUNT TRANSFORMER.

NOTE: APPLICABLE TO BOTH RESIDENTIAL AND COMMERCIAL SERVICES.

RESIDENTIAL
SEE "SLEMCO - SPECIFICATIONS FOR RESIDENTIAL UNDERGROUND SECONDARY REQUIREMENTS" FOR MORE INFORMATION.

COMMERCIAL
SEE "SLEMCO - SPECIFICATIONS FOR COMMERCIAL UNDERGROUND SECONDARY REQUIREMENTS" FOR MORE INFORMATION.

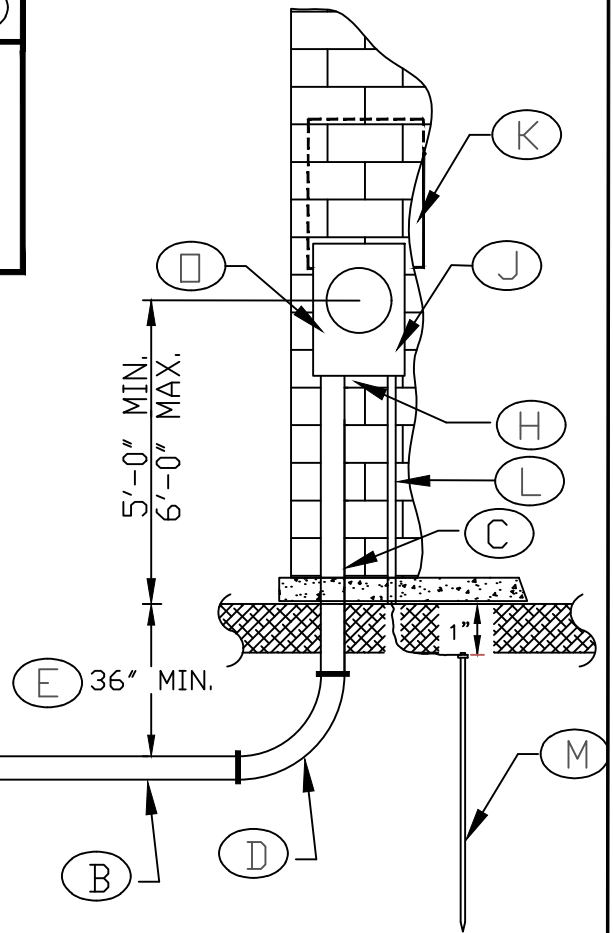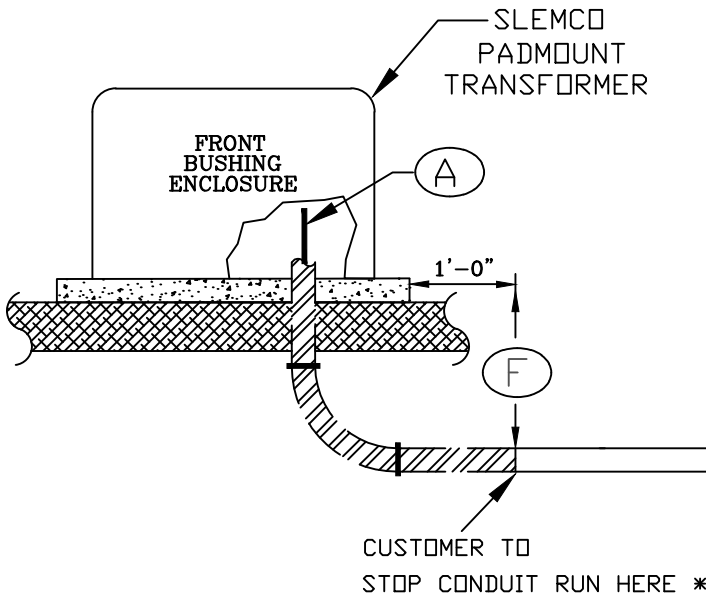

- INSTALLED BY SLEMCO
- INSTALLED BY CUSTOMER

* STOP CONDUIT RUN 1'-0" FROM PADMOUNT TRANSFORMER PAD OR PEDESTAL EDGE



SOUTHWEST LOUISIANA ELECTRIC
MEMBERSHIP CORPORATION
LOUISIANA 9 LAFAYETTE

**SINGLE-PHASE
UNDERGROUND SERVICE REQUIREMENTS
FROM AN EXISTING PADMOUNT TRANSFORMER**

DRAWN BY:		CREATED ON: 11/15/97	SCALE: N.T.S.
REVISIONS	REVISED BY	DATE	REV.
SPLIT OVERHEAD/UNDERGROUND SERVICE DRAWINGS	L. A. M.	09/28/99	2
	J. C. D.	03/01/11	3
ENHANCEMENT TO DRAWINGS & SPECIFICATIONS ADDED DETAILS FROM PAD	L. MECHE	02/12/15	4
MADE APPLICABLE TO RESIDENTIAL AND COMMERCIAL	H. H. H	03/29/19	5
			DRAWING NO. 2
			REV. 5

SLEMCO ELECTRICAL STANDARDS

APPROVED:	DATE:	PAGE NUMBER: 97
-----------	-------	-----------------

NOTE: APPLICABLE TO BOTH RESIDENTIAL AND COMMERCIAL SERVICES.

RESIDENTIAL


SEE "SLEMCO - SPECIFICATIONS FOR RESIDENTIAL UNDERGROUND SECONDARY REQUIREMENTS" FOR MORE INFORMATION ON ALPHA IDENTIFIERS.


SEE "SLEMCO - SPECIFICATIONS FOR RESIDENTIAL UNDERGROUND PRIMARY REQUIREMENTS" FOR MORE INFORMATION ON NUMERICAL IDENTIFIERS.


COMMERCIAL

SEE "SLEMCO - SPECIFICATIONS FOR COMMERCIAL UNDERGROUND SECONDARY REQUIREMENTS" FOR MORE INFORMATION ON ALPHA IDENTIFIERS.

SEE "SLEMCO - SPECIFICATIONS FOR COMMERCIAL UNDERGROUND PRIMARY REQUIREMENTS" FOR MORE INFORMATION ON NUMERICAL IDENTIFIERS.

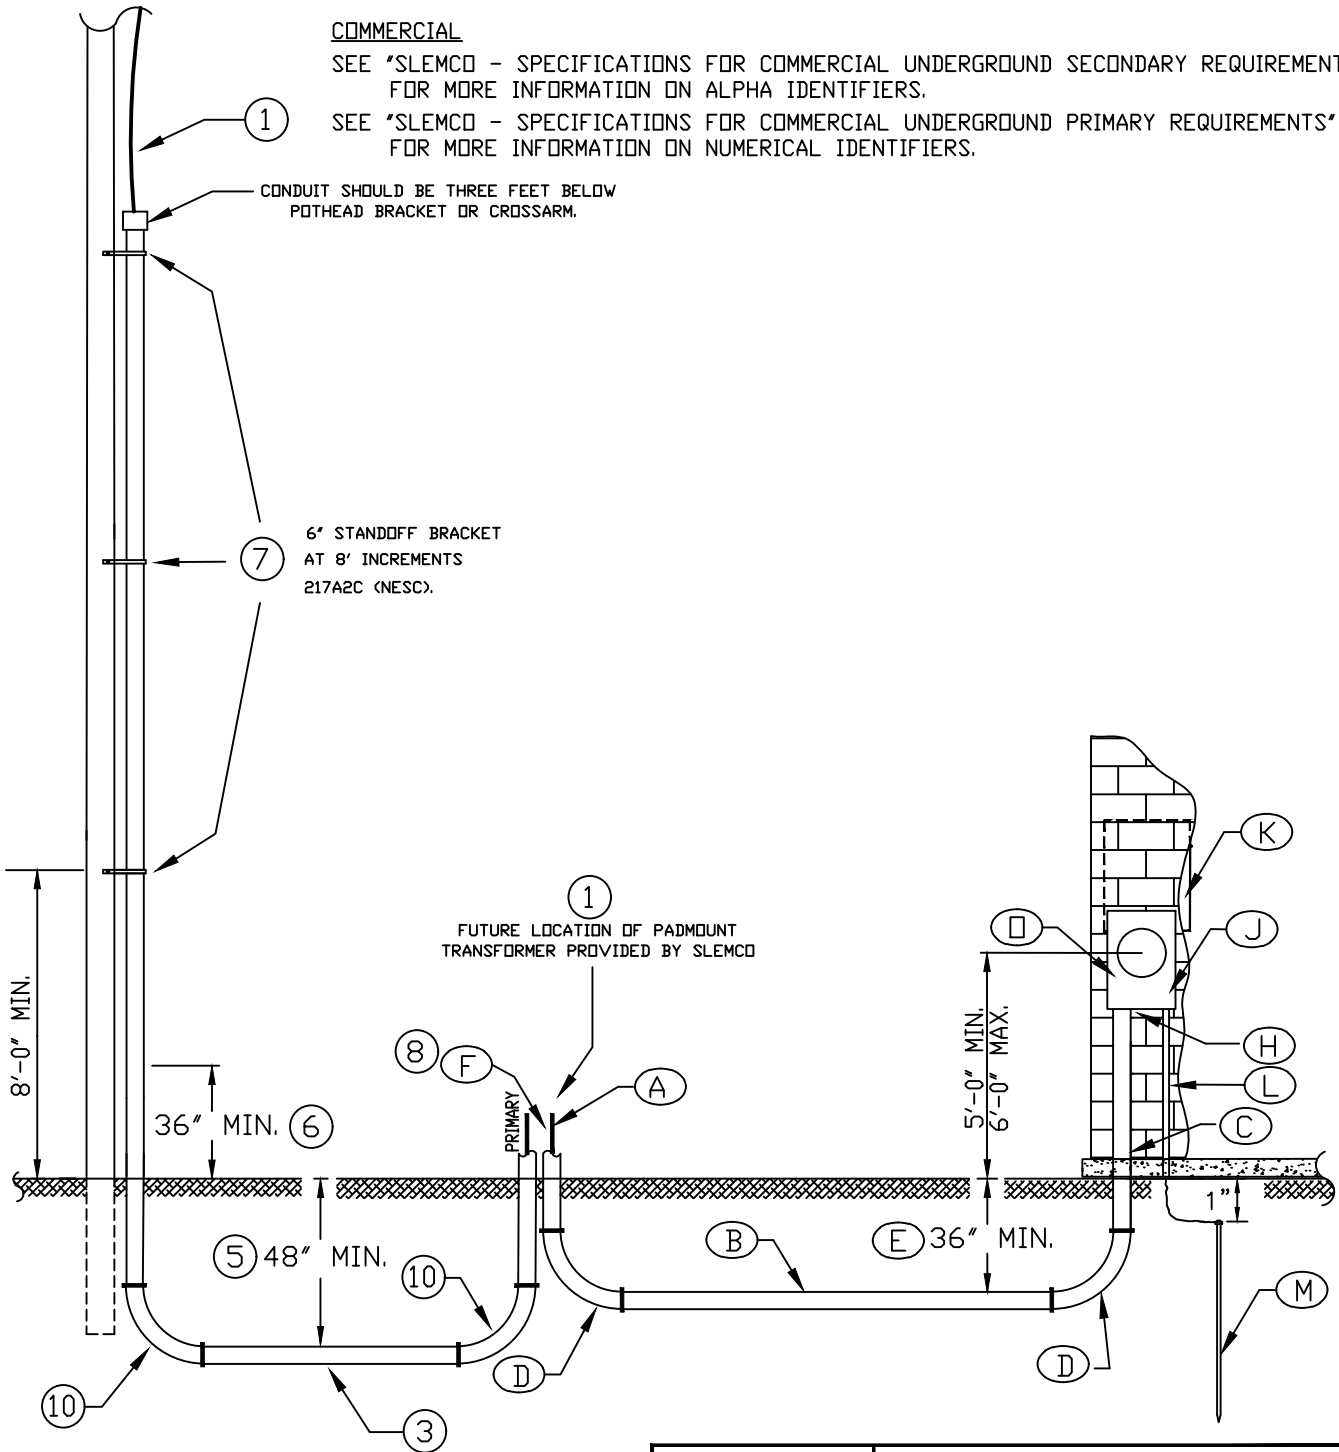

		SOUTHWEST LOUISIANA ELECTRIC MEMBERSHIP CORPORATION LOUISIANA 9 LAFAYETTE			
		SINGLE-PHASE UNDERGROUND SERVICE REQUIREMENTS FROM A NEW PADMOUNT TRANSFORMER			
DRAWN BY: L. MECHE		CREATED ON: 10/22/14	SCALE: N.T.S.		
REVISIONS		REVISED BY	DATE	REV.	DRAWING NO.
MADE APPLICABLE TO RESIDENTIAL AND COMMERCIAL		H . H . H	03/29/19	1	3
APPROVED:		DATE:	PAGE NUMBER:		
			98		

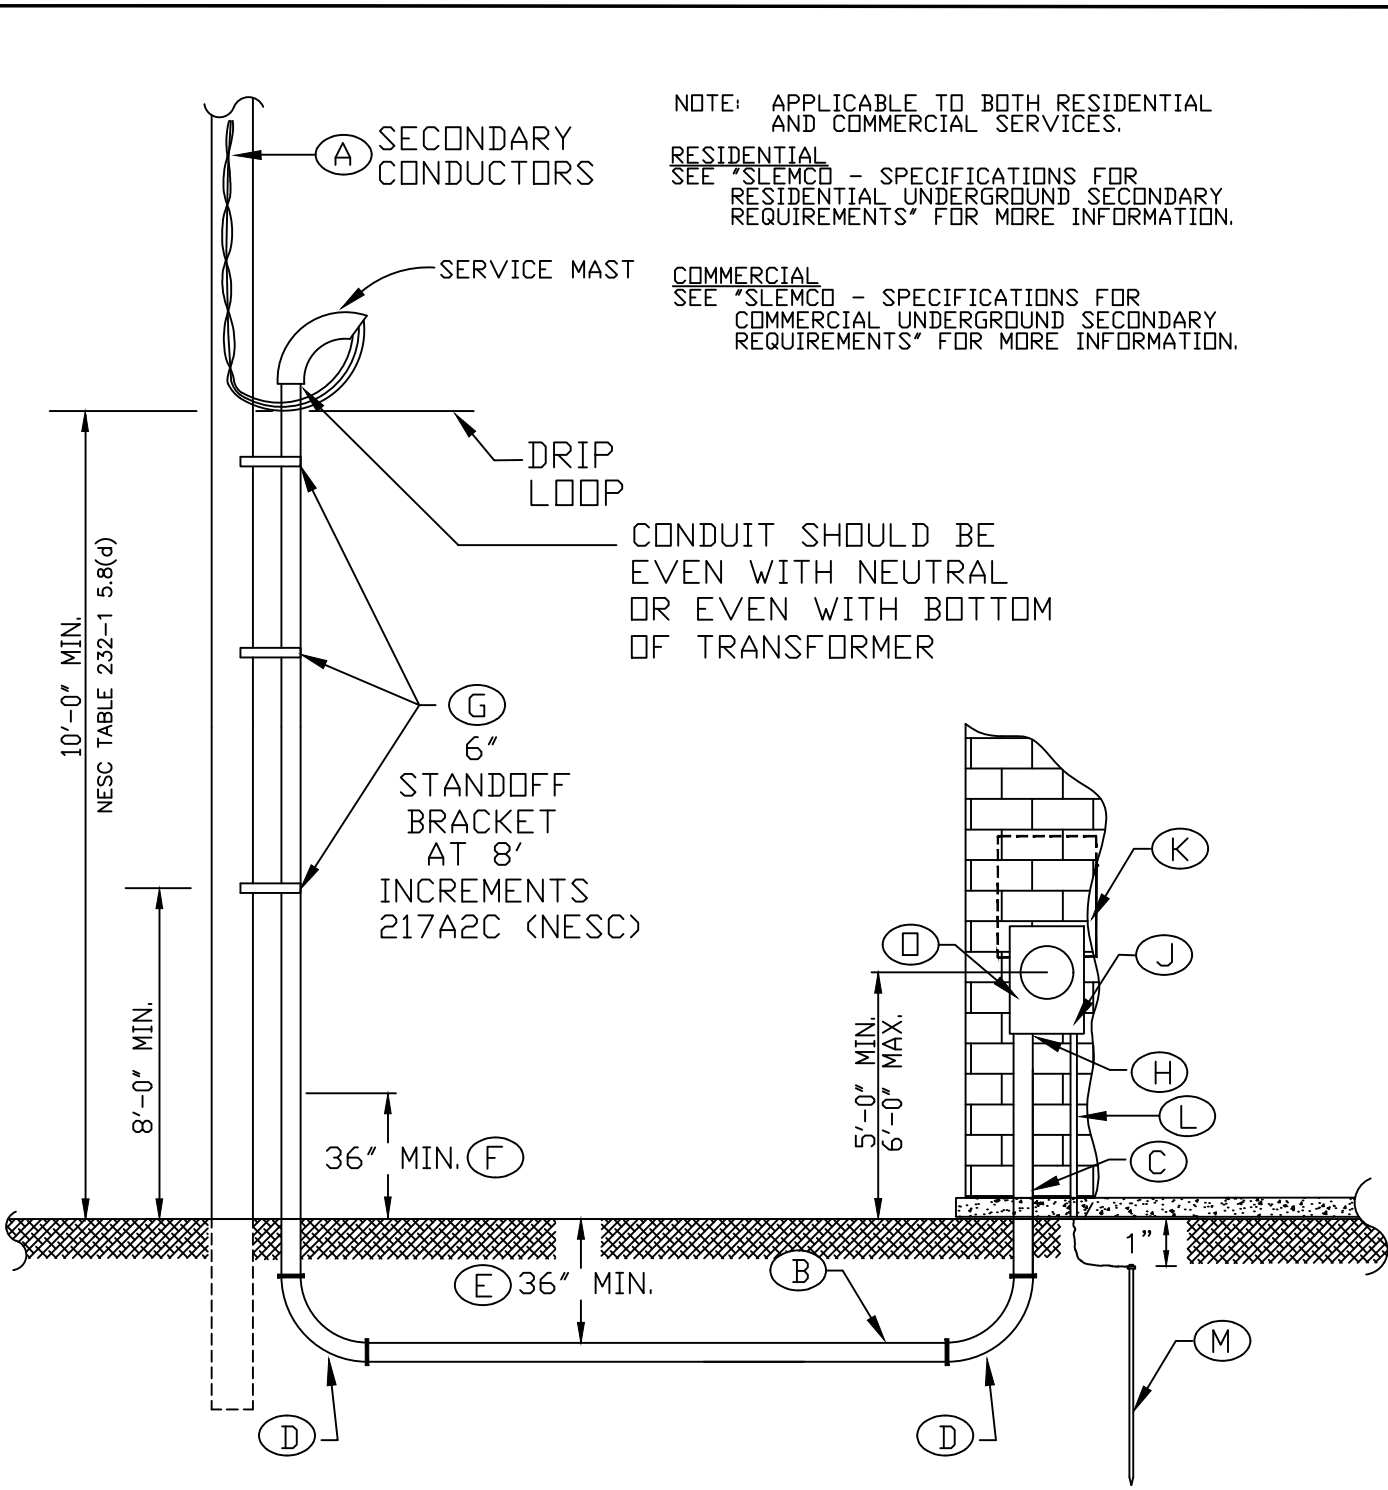

NOTE: APPLICABLE TO BOTH RESIDENTIAL AND COMMERCIAL SERVICES.

RESIDENTIAL
SEE "SLEMCO - SPECIFICATIONS FOR RESIDENTIAL UNDERGROUND SECONDARY REQUIREMENTS" FOR MORE INFORMATION.

COMMERCIAL
SEE "SLEMCO - SPECIFICATIONS FOR COMMERCIAL UNDERGROUND SECONDARY REQUIREMENTS" FOR MORE INFORMATION.

CONDUIT SHOULD BE EVEN WITH NEUTRAL OR EVEN WITH BOTTOM OF TRANSFORMER

		SOUTHWEST LOUISIANA ELECTRIC MEMBERSHIP CORPORATION LOUISIANA 9 LAFAYETTE				
		SINGLE-PHASE UNDERGROUND SERVICE REQUIREMENTS FROM AN OVERHEAD SOURCE				
DRAWN BY:		CREATED ON: 01/15/97		SCALE: N.T.S.		
REVISIONS		REVISED BY	DATE	REV.	DRAWING NO.	REV.
SPLIT UNDERGROUND/OVERHEAD DRAWINGS		L. A. M.	09/05/99	2	4	4
		J. C. D.	03/01/11	3		
ENHANCEMENT TO DRAWINGS & SPECIFICATIONS		L. MECHE	04/21/16	4		
MADE APPLICABLE TO RESIDENTIAL AND COMMERCIAL		H. H. H	03/29/19	5		

SLEMCO ELECTRICAL STANDARDS		
APPROVED:	DATE:	PAGE NUMBER:
		99