

NOTE: APPLICABLE TO BOTH RESIDENTIAL AND COMMERCIAL SERVICES.

RESIDENTIAL


SEE "SLEMCO - SPECIFICATIONS FOR RESIDENTIAL UNDERGROUND SECONDARY REQUIREMENTS" FOR MORE INFORMATION ON ALPHA IDENTIFIERS.


SEE "SLEMCO - SPECIFICATIONS FOR RESIDENTIAL UNDERGROUND PRIMARY REQUIREMENTS" FOR MORE INFORMATION ON NUMERICAL IDENTIFIERS.

COMMERCIAL

SEE "SLEMCO - SPECIFICATIONS FOR COMMERCIAL UNDERGROUND SECONDARY REQUIREMENTS" FOR MORE INFORMATION ON ALPHA IDENTIFIERS.

SEE "SLEMCO - SPECIFICATIONS FOR COMMERCIAL UNDERGROUND PRIMARY REQUIREMENTS" FOR MORE INFORMATION ON NUMERICAL IDENTIFIERS.

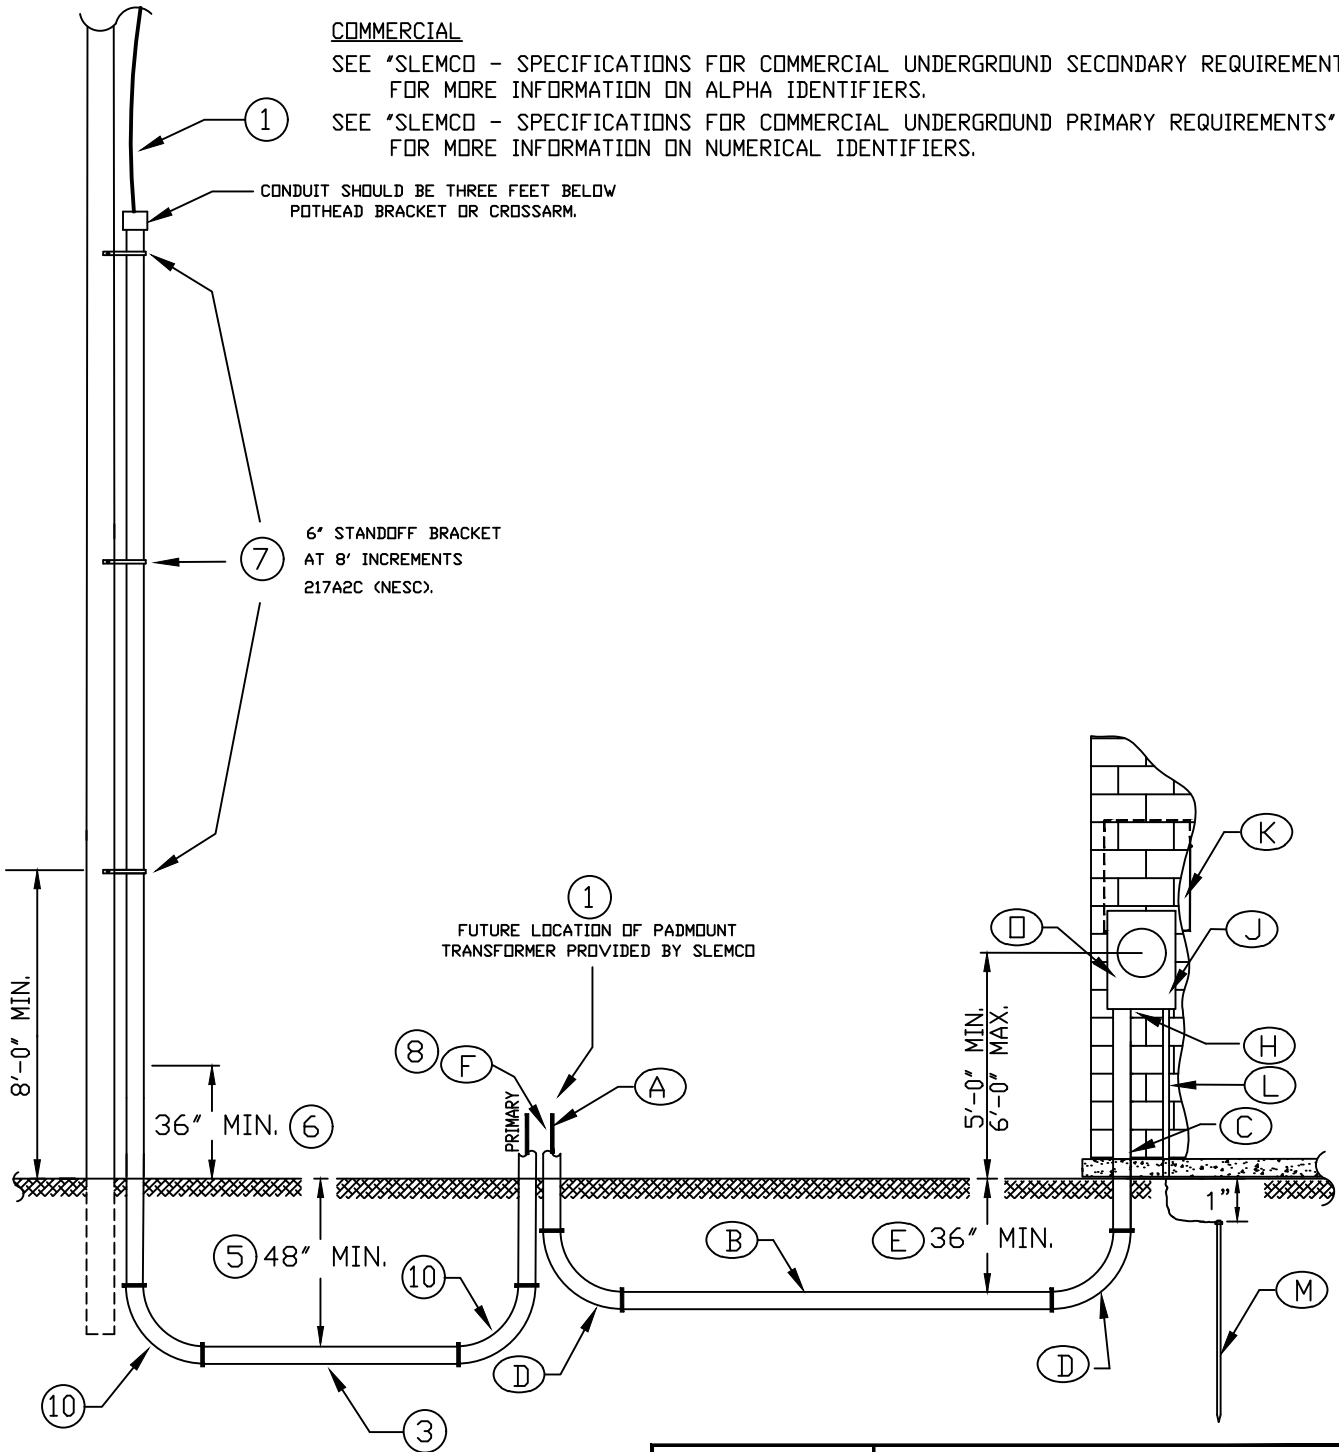

		SOUTHWEST LOUISIANA ELECTRIC MEMBERSHIP CORPORATION LOUISIANA 9 LAFAYETTE			
		SINGLE-PHASE UNDERGROUND SERVICE REQUIREMENTS FROM A NEW PADMOUNT TRANSFORMER			
DRAWN BY: L. MECHE		CREATED ON: 10/22/14	SCALE: N.T.S.		
REVISIONS		REVISED BY	DATE	REV.	DRAWING NO.
MADE APPLICABLE TO RESIDENTIAL AND COMMERCIAL		H . H . H	03/29/19	1	3
APPROVED:		DATE:	PAGE NUMBER:		
			13		